



Overall Evaluation for RFQ # Q-20-11-COC

Project

Security System Improvement Project for the Claude H. Dyal Water Treatment Plant and other Remote Facilities

Firm being Evaluated


Integrated Fire and Security Solutions

Evaluators

Katie Ennis, Kevin Joseph & Troy Howell

Date Evaluated

Wednesday, June 10, 2020

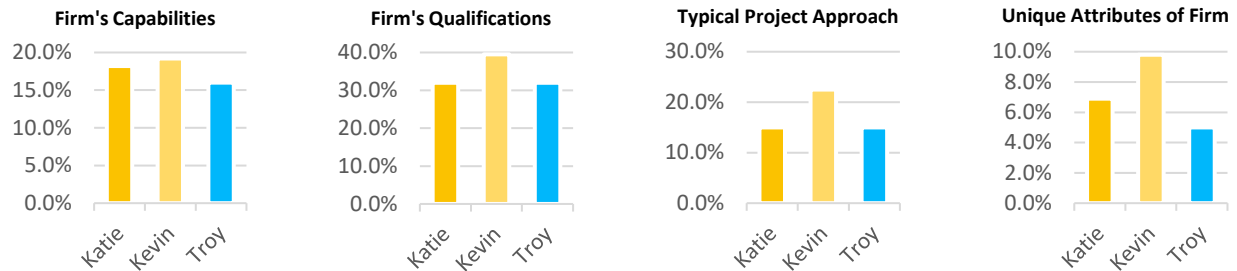

Overall Average Score

This Firm was evaluated based on Four (4) Criteria:

Criteria

Firm's Capabilities with weight of 20%

Firm's Qualifications with weight of 40%

Typical Project Approach with weight of 30%

Unique Attributes of Firm with weight of 10%

The Four (4) Criteria consisted of 28 areas that were evaluated as follows:


Evaluation Scale

0 - Not Covered in Proposal

1 to 4 - Less than Adequate

5 to 7 - Adequate

8 to 10 - More than Adequate

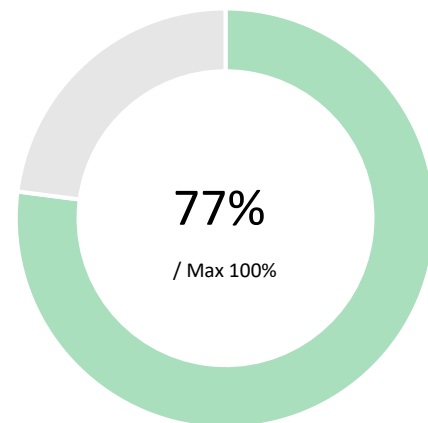



Evaluation for RFQ # Q-20-11-COC

Project

Security System Improvement Project for the Claude H. Dyal Water Treatment Plant and other Remote Facilities

Firm being Evaluated

Integrated Fire and Security Solutions


Evaluator

Katie Ennis


Date Evaluated

Monday, June 8, 2020


Firm's Capabilities




Firm's Qualifications




Typical Project Approach



Unique Attributes of Firm



Overall Score

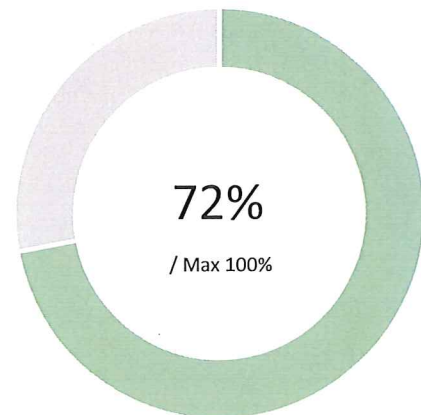

This Firm was evaluated based on Four (4) Criteria:

Criteria

Firm's Capabilities with weight of 20%

Firm's Qualifications with weight of 40%

Typical Project Approach with weight of 30%

Unique Attributes of Firm with weight of 10%

The Four (4) Criteria consisted of 28 areas that were evaluated as follows:

Evaluation Scale

0 - Not Covered in Proposal

1 to 4 - Less than Adequate

5 to 7 - Adequate

8 to 10 - More than Adequate



Evaluation for RFQ # Q-20-11-COC

Project

Security System Improvement Project for the Claude H. Dyal Water Treatment Plant and other Remote Facilities

Firm being Evaluated

Integrated Fire and Security Solutions


Evaluator

Kevin Joseph, MSCE, E.I.


Date Evaluated

Tuesday, May 12, 2020


Firm's Capabilities




Firm's Qualifications




Typical Project Approach



Unique Attributes of Firm



Overall Score

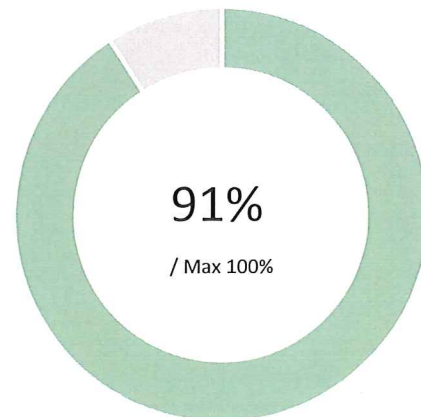

This Firm was evaluated based on Four (4) Criteria:

Criteria

Firm's Capabilities with weight of 20%

Firm's Qualifications with weight of 40%

Typical Project Approach with weight of 30%

Unique Attributes of Firm with weight of 10%

The Four (4) Criteria consisted of 28 areas that were evaluated as follows:

Evaluation Scale

0 - Not Covered in Proposal

1 to 4 - Less than Adequate

5 to 7 - Adequate

8 to 10 - More than Adequate



Evaluation for RFQ # Q-20-11-COC

Project

Security System Improvement Project for the Claude H. Dyal Water Treatment Plant and other Remote Facilities

Firm being Evaluated

Integrated Fire and Security Solutions


Evaluator

Troy Howell


Date Evaluated

Wednesday, June 10, 2020


Firm's Capabilities




Firm's Qualifications




Typical Project Approach



Unique Attributes of Firm



Overall Score

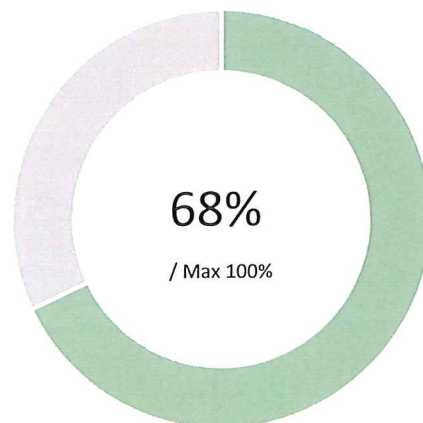

This Firm was evaluated based on Four (4) Criteria:

Criteria

Firm's Capabilities with weight of 20%

Firm's Qualifications with weight of 40%

Typical Project Approach with weight of 30%

Unique Attributes of Firm with weight of 10%

The Four (4) Criteria consisted of 28 areas that were evaluated as follows:

Evaluation Scale

0 - Not Covered in Proposal

1 to 4 - Less than Adequate

5 to 7 - Adequate

8 to 10 - More than Adequate