



**SEE SHEET 8 FOR SITE DIMENSIONING AND
SIGNING AND MARKING INFORMATION**

1. NFPA 1 18.2.4.1.1 "THE REQUIRED WIDTH OF A FIRE DEPARTMENT ACCESS ROAD SHALL NOT BE OBSTRUCTED IN ANY MANNER, INCLUDING BY THE PARKING OF VEHICLES."
2. NFPA 1 18.5.7.1 A 36 IN. (914 MM) CLEAR SPACE SHALL BE MAINTAINED AROUND THE CIRCUMFERENCE OF FIRE HYDRANTS EXCEPT AS OTHERWISE REQUIRED OR APPROVED.
3. NFPA 1 18.5.7.2 A CLEAR SPACE OF NOT LESS THAN 60 IN. (1524 MM) SHALL BE PROVIDED IN FRONT OF EACH HYDRANT CONNECTION HAVING A DIAMETER GREATER THAN 2-1/2 IN. (64 MM).

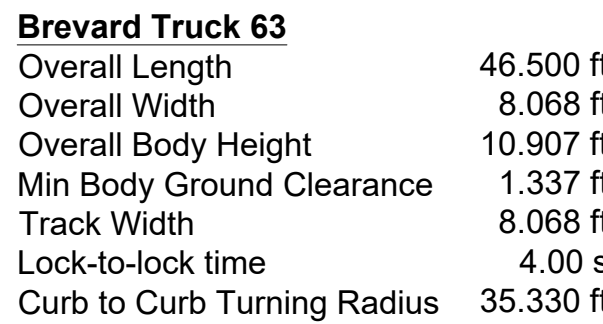

MINIMUM REQUIRED NUMBER OF HANDICAP STALLS = 9 STALLS
10 PROVIDED HANDICAP STALLS



SYMBOLS SHOWN ARE GRAPHIC IN NATURE. DUE TO SCALE, ALL DESIGN ELEMENTS ARE NOT NECESSARILY SHOWN ON PLAN VIEWS. THE CONTRACTOR SHALL ALSO REFER TO SPECIFICATION AND DETAIL SHEETS AS WELL AS THE COMPLETE PLAN SET.